



# Asbestos Medical Surveillance Program Process for Occupational Health Clinics

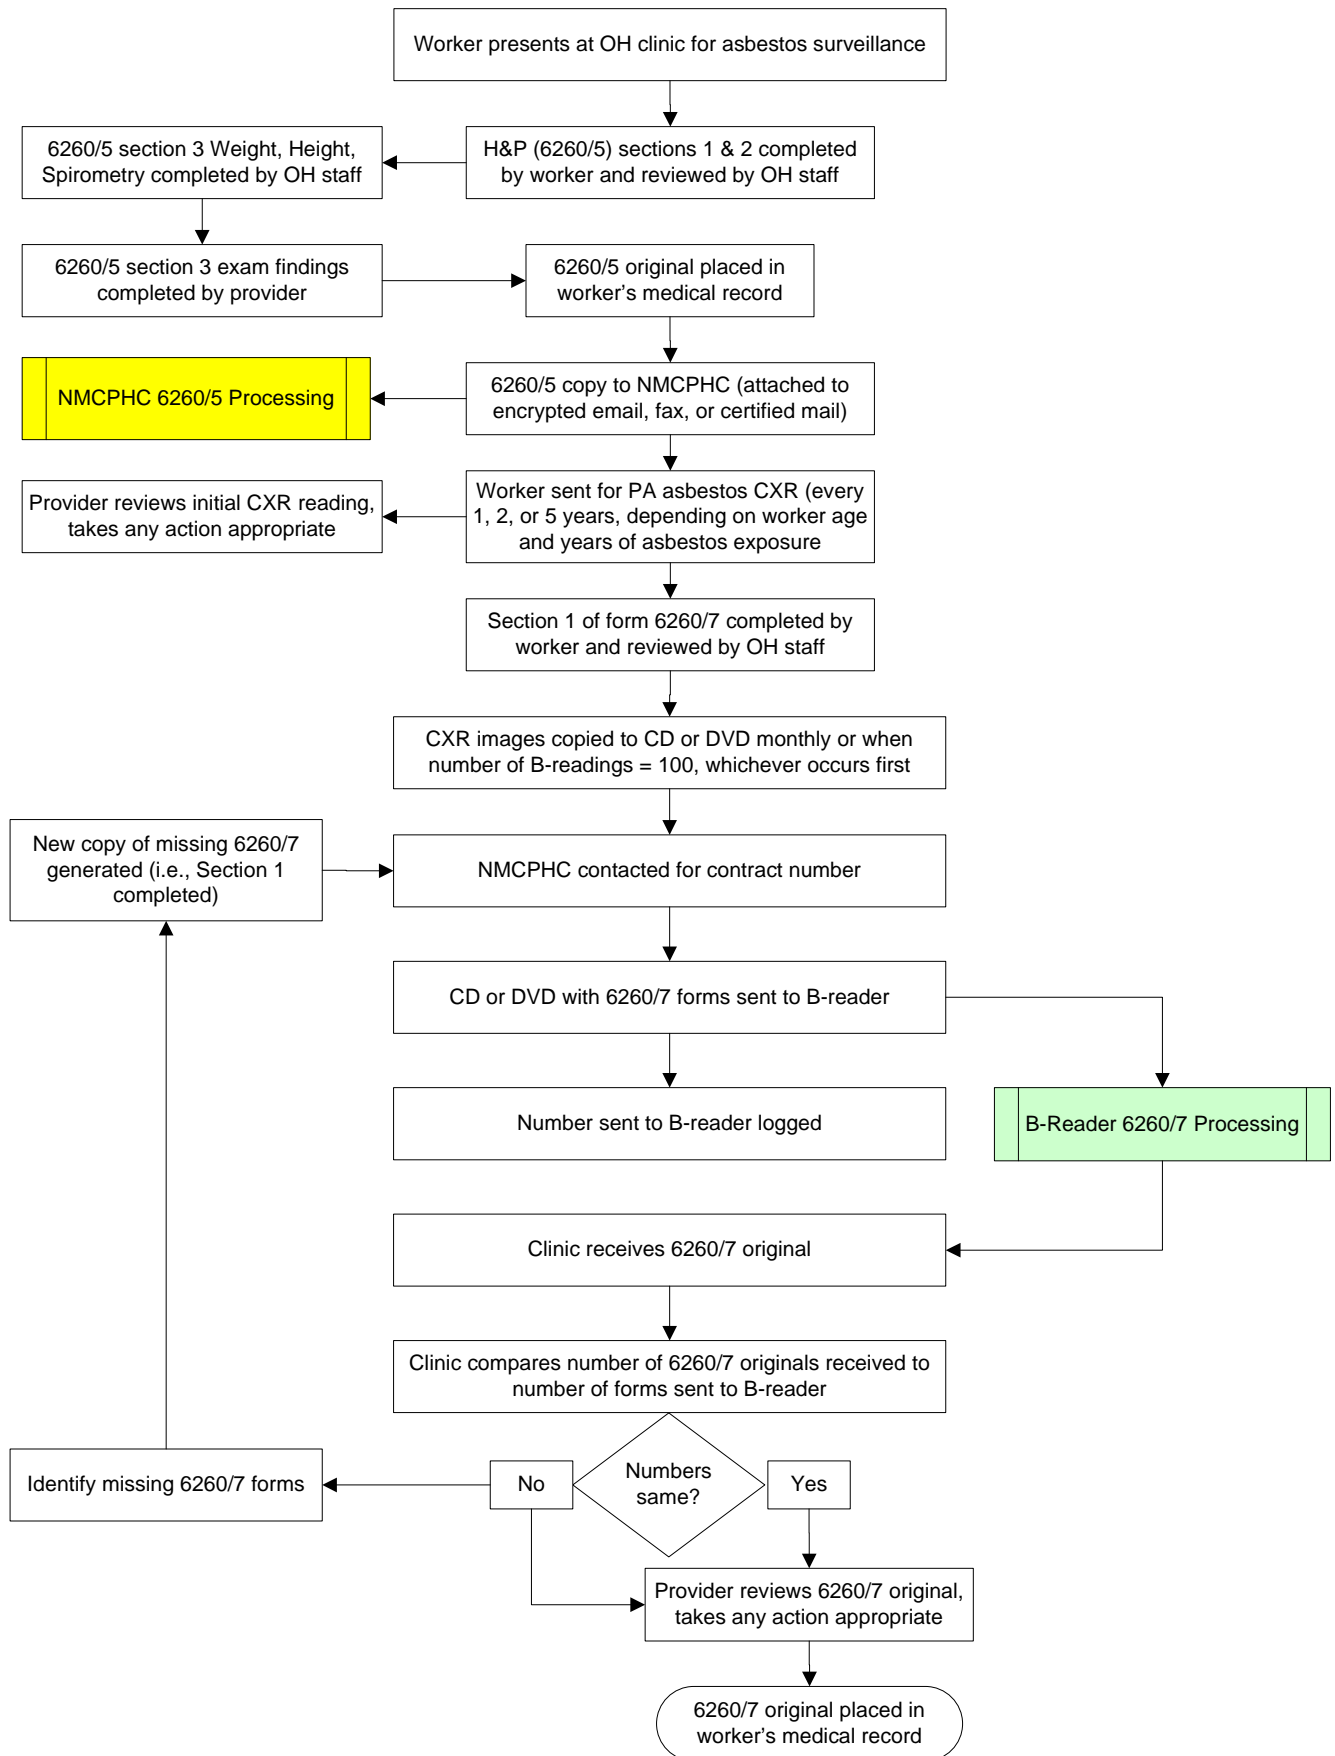


# Asbestos Medical Surveillance Program Forms Process for NMCPHC

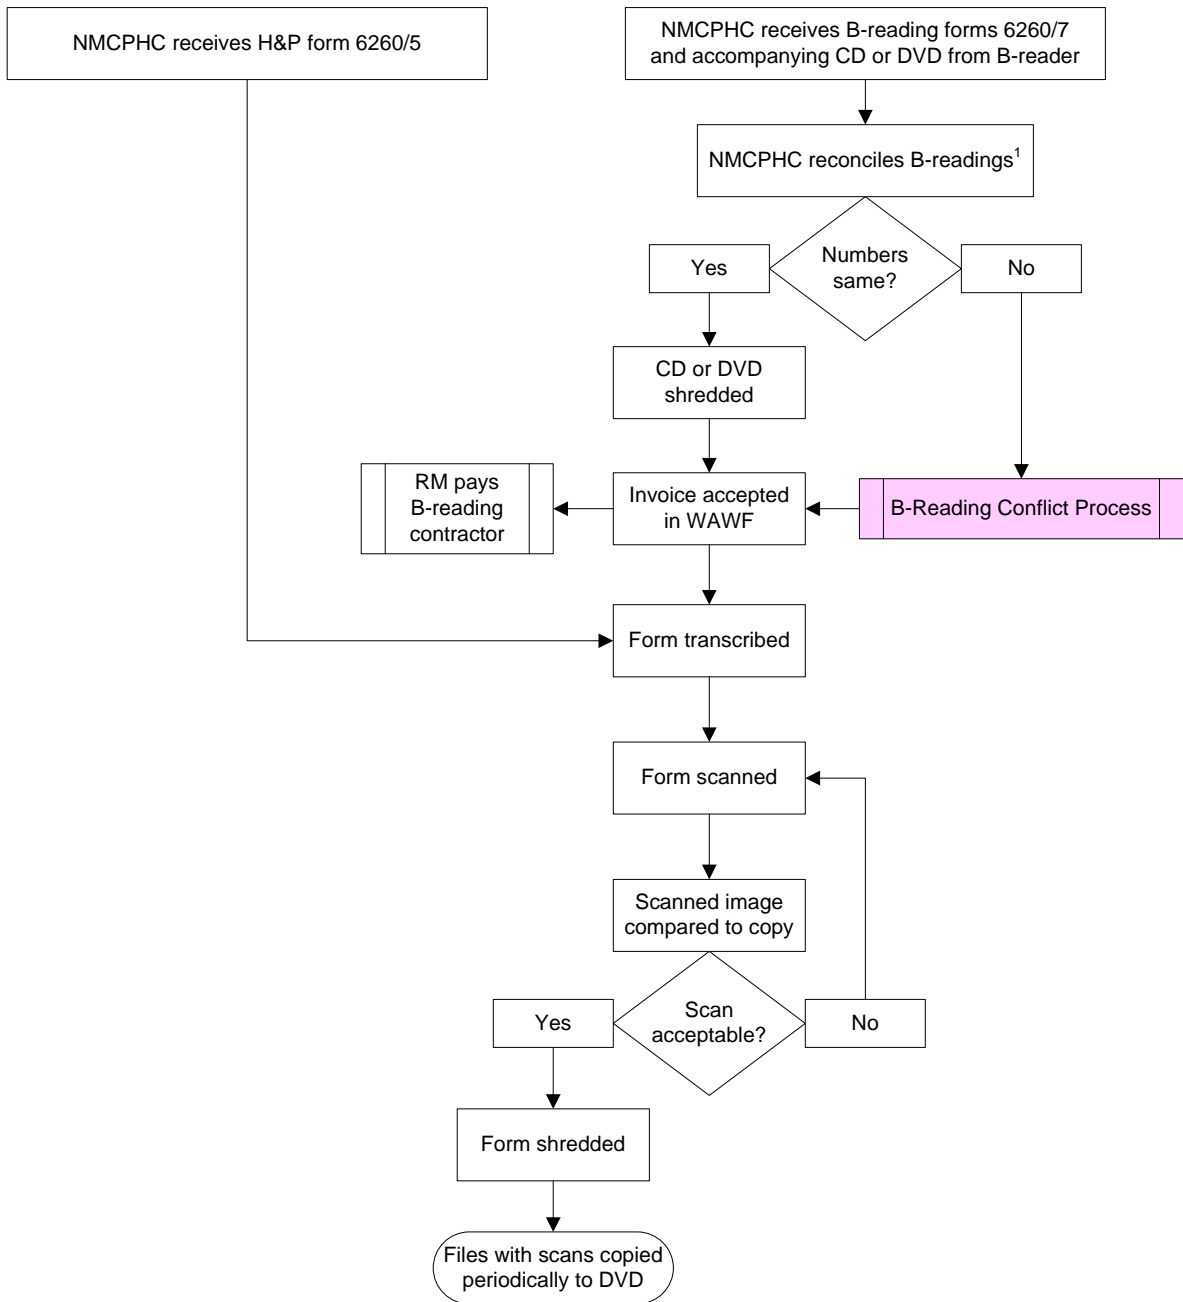

<sup>1</sup> Compare number reported by clinic and number submitted by B-reader and verify they are the same.


## Asbestos Medical Surveillance Program B-Reading Conflict Process

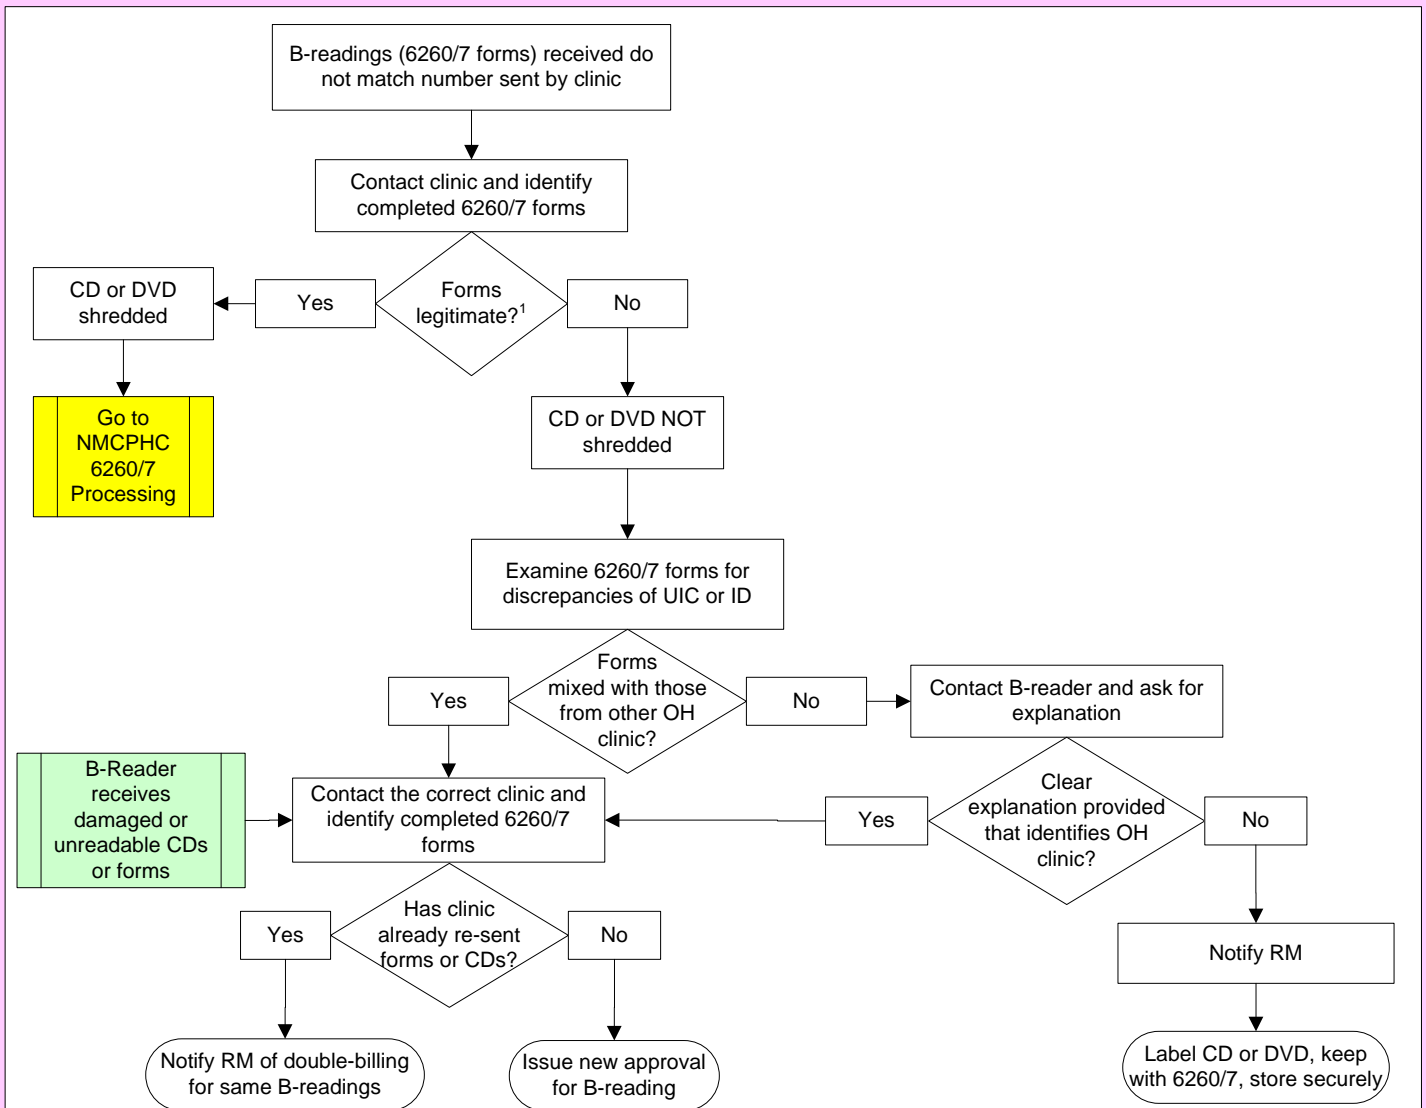

<sup>1</sup> I.e., the B-readings (6260/7) are identified but not verified as coming from an OH clinic.

<sup>2</sup> I.e., the first B-readings involved defective or incorrectly completed CDs or forms, and that those were already re-sent by the OH clinic, so there will be 2 bills by the B-reader for that batch (the unreadable ones and the readable ones).

## Asbestos Medical Surveillance Program Process for B-Readers

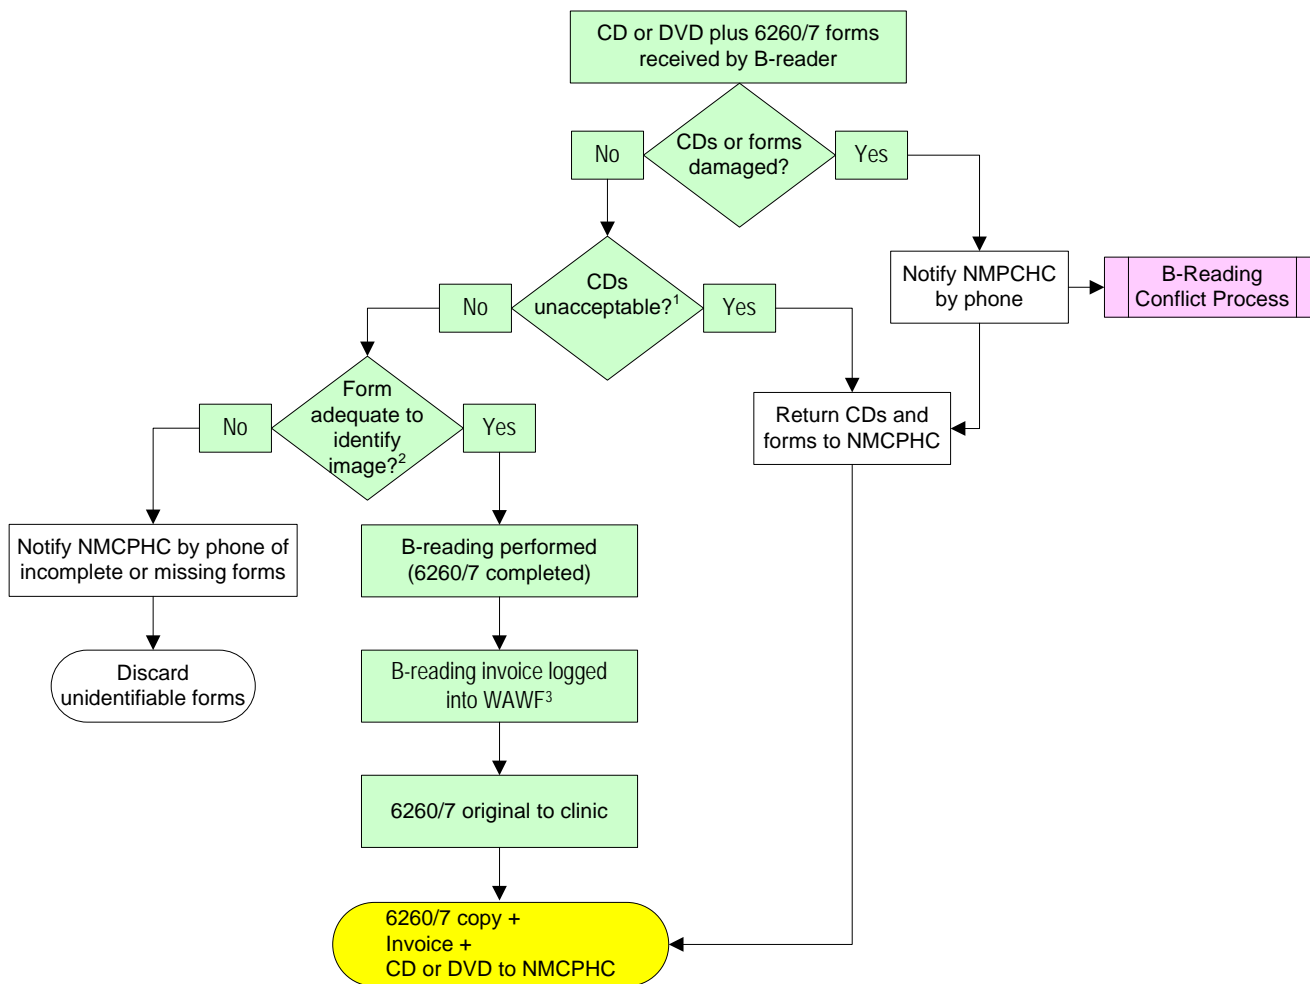

<sup>1</sup> Only 1 image per CD or CD unreadable

<sup>2</sup> Name or SSN or DoD ID present and legible

(If those are not there, then the form does not have enough information to be consider PII and may be disposed of as trash.)

<sup>3</sup> Wide Area Work Flow